

Hangzhou Easy Electric Wire and Cable Co.,LTD

Add: Room 305, Building 2, No. 380 Fengxin Road, Hangzhou, China

[www.eescable.com](http://www.eescable.com)

## TEST REPORT

Name: Triplex ABC Cable Number: PUO.20220930001


Model : 2\*1/0AWG(AAC/XLPE)+1\*1/0AWG (AAAC) Inspection date: 2022.10.24

Length: 95km Test basis: Technical protocol

NO.	Test items	unit	standard requiremen	test result
1	structure size			
1.1	Conduct single -line root number	root/m m	Phase conductor 7/3.12 carrier line 7/3.37	Phase conductor 7/3.12 carrier line 7/3.37
1.2	Aluminum single -wire tensile strength Carrier line resistance intensity	N/mm 2	$\geq 170$ $\geq 315$	187 190 332
1.3	Gangster outer diameter	mm	Phase line 9.36 Bearing line 10.11	Phase line 9.36 Bearing line 10.10
1.4	Twisted		Phase line right bearing line right	Phase line right bearing line right
1.5	Section ratio	times	Phase line 10-16 carrier line 12-14.5	Phase line 14.6 Bearing line 13.6
1.6	Carrier line tension	KN	$\geq 19.66$	21.03
2	Insulation Materials		XLPE	XLPE
2.1	Insulation average thickness	mm	$\geq 1.52$	1.62 1.60
2.2	The thinnest thickness	mm	$\geq 1.40$	1.54 1.51
2.3	Insulation outer diameter	mm	$\geq 12.4$	12.5 12.5
3	The maximum DC resistance of the	$\Omega/\text{km}$	Phase conductor 0.55 Carrying conductor 0.5348	Phase conductor 0.523 Carrying conductor 0.5214

**Hangzhou Easy Electric Wire and Cable Co.,LTD**

Add: Room 305, Building 2, No. 380 Fengxin Road, Hangzhou, China

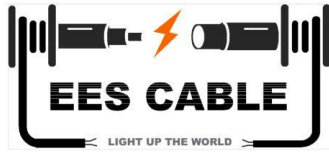

## Hangzhou Easy Electric Wire and Cable Co.,LTD

Add: Room 305, Building 2, No. 380 Fengxin Road, Hangzhou, China

[www.eescable.com](http://www.eescable.com)

	conductor(20 ° C)			
4	AC voltage	kV	3.5kV/1min no breakdown	No breakdown
5	Carbon black content	%	≥1.5	1.61
6	Heat extension test			
6.1	Load extension rate	%	≤175	60 55
6.2	Permanent extension rate after cooling	%	≤15	0 0
7	Printing		Laser jet printing according to the contract	accord with
7.1	Cable twisted	mm	Right	Right
7.2	Sequence of cables		Phase A, B, bearing line	accord with
7.3	Cable to form a diameter ratio	times	25-60 times of outer diameter of phase line	38
8	Cable diameter	mm	24.86	24.90
<p>Conclusion: The project's project meets the requirements of technical agreement standards.</p>				

Test: Jin Xiaoping

Review: Shi Dongdong

approve: Wang Aihong

杭州益睿电线电缆有限公司  
HANGZHOU EASY ELECTRIC WIRE AND CABLE CO., LTD.

**Hangzhou Easy Electric Wire and Cable Co.,LTD**

Add: Room 305, Building 2, No. 380 Fengxin Road, Hangzhou, China